


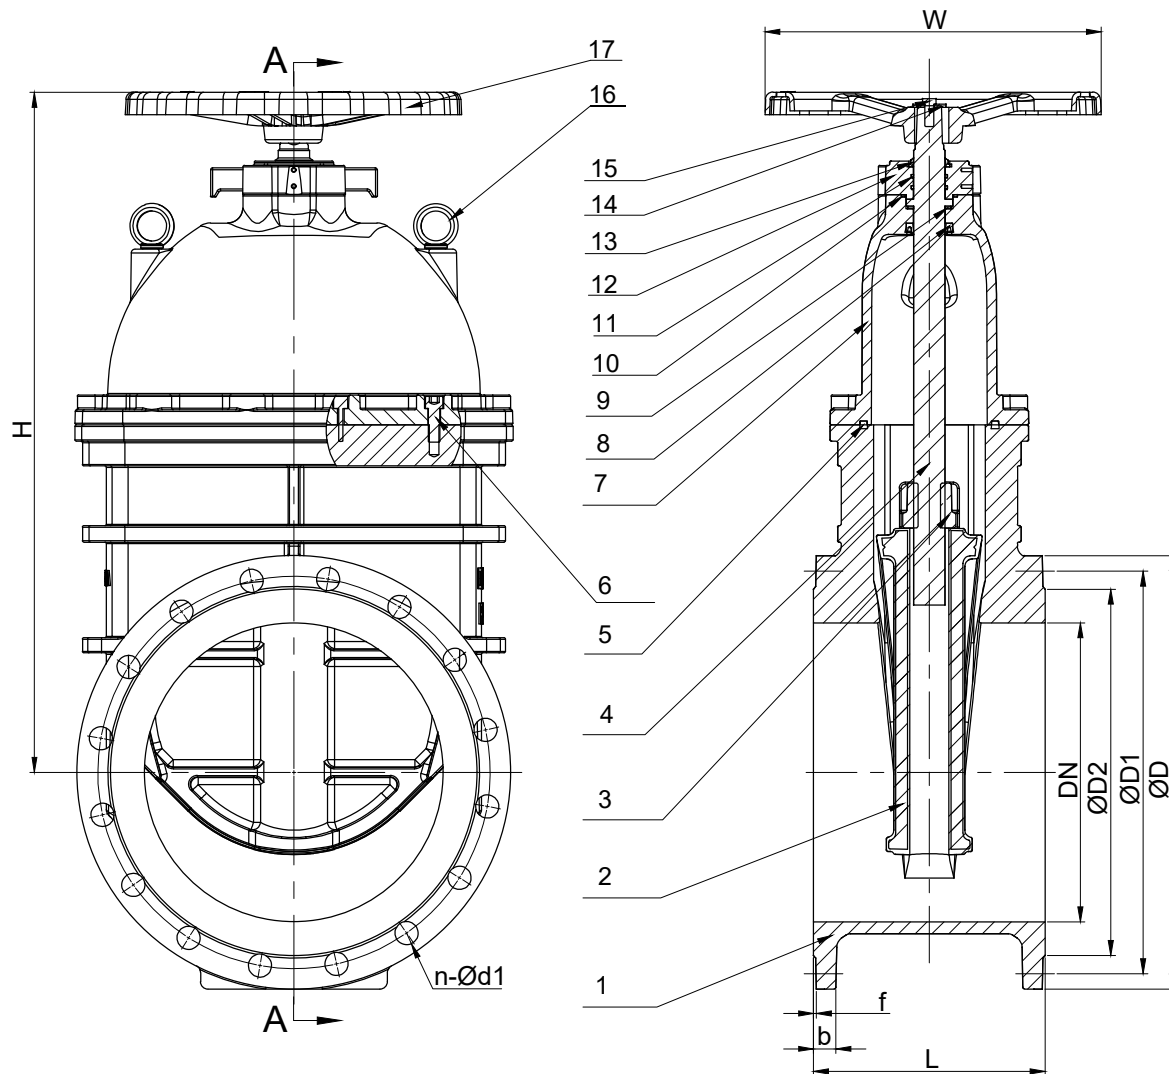

Pressure Test To ISO5208			
DN	Pressure Rating(PN)	Hydro-Test Pressure(Mpa)	
		Body	Seat
350-400	25	3.75	2.75

1. Design According to :DIN3352.
2. Face to Face Dimension according to DIN3202-F4.
3. Flange drilling according to EN1092-2 PN25
4. Test According to ISO 5208.

17	Handwheel	Ductile iron		
16	Eye Bolt	Galvanized Steel		
15	Bolt	Galvanized Steel		
14	Washer	Galvanized Steel		
13	Dustproof Ring	EPDM		
12	Gland	DI GGG50		
11	O Ring	EPDM		
10	O Ring	EPDM		
9	Stem Washer	Nylon		
8	V Ring	EPDM		
7	Bonnet	DI GGG50		
6	Bolt	Galvanized Steel		
5	Bonnet Gasket	EPDM		
4	Stem	SS420		
3	Wedge Nut	Brass		
2	Wedge	DI GGG50+EPDM		
1	Body	DI GGG50		

DRN	wang	WEIGHT		MATERIAL
CHK		SCALE		
APP		DATE	08/09/2024	Resilient Seal Gate Valve

hiwa

REV 20240809a

CZ0005

Size	L	ΦD	ΦD1	ΦD2	n-Φd1	f	b	H	W
DN350	290	555	490	448	16-34	4	30	820	600
DN400	310	620	550	503	16-37	4	32	915	600